

GUIDELINE ON BOUNDARY NOISE LIMIT FOR CENTRALISED AIR CONDITIONING AND VENTILATION SYSTEMS IN NON-INDUSTRIAL BUILDINGS

1. Scope

This guideline sets out the maximum boundary noise emission limits for centralised air conditioning and ventilation systems in non-industrial buildings. The adoption of the guideline would help minimise noise nuisances from such sources. It was developed by NEA in consultation with the Singapore Institute of Architects, Institute of Engineers Singapore and the Association of Consulting Engineers Singapore.

Qualified Persons may use the Guideline in their specification, design and installation of centralised air conditioning and mechanical ventilation systems in non-industrial buildings.

2. Boundary Noise Limits

The noise level from the centralised airconditioning or ventilation system should not exceed the following boundary noise limits subject to applicable correction factors as per paragraphs 4 and 5 below:

Type of affected premises	Boundary noise limit (reckoned as the equivalent continuous noise level over 15 minutes) in decibels (dBA)		
	Day 7 am to 7 pm	Evening 7 pm to 11 pm	Night 11 pm to 7 am
Noise Sensitive Premises such as hospital, home for the aged sick, library, etc	60	55	50
Residential Premises	65	60	55

3. Measurement Points

- (a) For equipment installed at ground level, the noise measurement should be made at the site boundary.
- (b) For equipment that is installed above ground level e.g. at roof-top, the noise level shall be computed for a point that is at the site boundary and at the same height as the equipment. The locations for noise measurements are at **Annex 1**. The methodology/example of the computation to be used is at **Annex 2**.

4. Background Noise Correction Factor

The adjusted value for the maximum noise level shall be obtained by adding the correction factor corresponding to the difference between the maximum permitted level and the background noise level, set out in the Table below, to the higher of the 2 noise levels.

<i>Difference between 2 noise levels in decibels (A)</i>	<i>Correction factor in decibels (A)</i>
(a) Below 2	3
(b) 2 to less than 4	2
(c) 4 to less than 10	1
(d) 10 and above	Nil

5. 'Modifying Factor' Adjustments

Where a noise source contains certain characteristics, such as tonality, impulsiveness, intermittency, irregularity or dominant low frequency content, there is evidence to suggest that it can cause greater annoyance than other noise at the same level and a penalty of 5 dBA shall be added for each of the following characteristics, up to a maximum of 10 dBA, in accordance with **Annex 3**.

On the other hand, some sources may cause less annoyance where only a single event occurs for a limited duration. The adjustments for duration are given in also given in **Annex 3**.

6. Type of Noise Meter

Measurements of noise levels for the purposes of this Guideline shall be carried out with a noise meter which complies with the standards specified in the International Electrotechnical Commission Publication 651 (Type 1) and Publication 804 (Type 1), or any other comparable standards.


7. References

Environmental Pollution Control (Boundary Noise Limits for Factory Premises) Regulations, 1999, National Environment Agency, Singapore


New South Wales Industrial Noise Policy, Jan 2000, New South Wales Environment Protection Authority, Australia

LOCATION FOR NOISE MEASUREMENT


Case 1 : Equipment at Ground Level

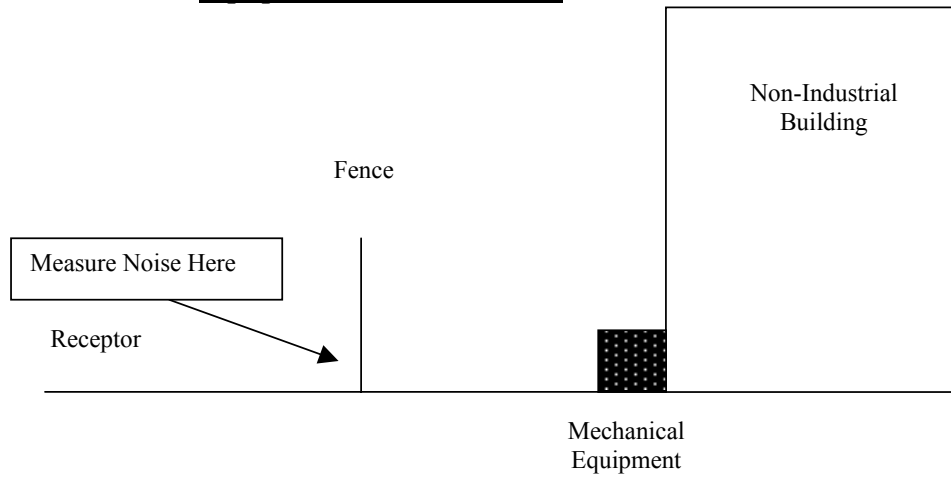

Case 2: Equipment above Ground Level

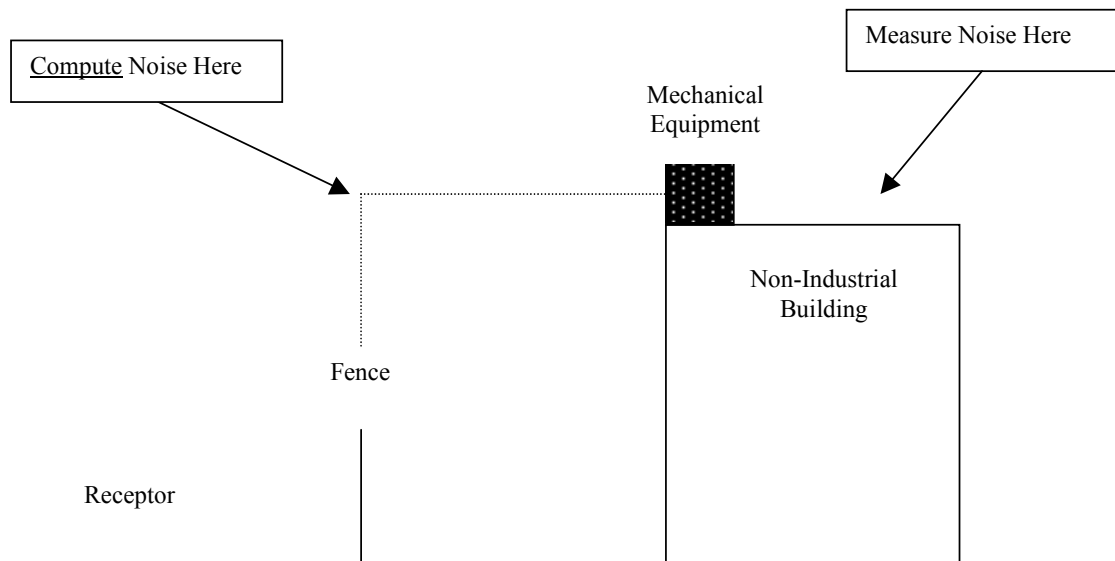

COMPUTATION OF NOISE LEVELS

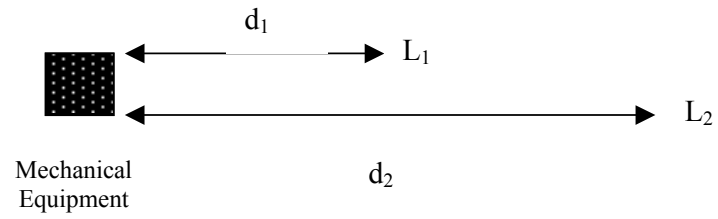

The noise level measured at distance d_1 is L_1 (in dBA).
The computed noise level at distance d_2 is L_2 (in dBA).

$$L_2 = L_1 - 20\log(d_2/d_1)$$

‘MODIFYING FACTOR’ ADJUSTMENTS

Definitions to support the modifying factor corrections

Tonal noise –containing a prominent frequency and characterised by a definite pitch.

Low-frequency noise –containing major components within the low frequency range (20Hz-250Hz) of the frequency spectrum.

Impulsive noise –having a high peak of short duration or a sequence of such peaks.

Intermittent noise –the level suddenly drops to that of the background noise several times during the assessment period, with a noticeable change in noise level of at least 5 dB.

Adjustment for duration –applied where a single event noise is continuous for a period of less than two and a half hours in any 24-hour period. The acceptable noise level may be increased by the adjustment shown in *Table 1.2*. This adjustment is designed to account for unusual and one-off events, and does not apply to regular high-noise levels that occur more frequently than once per day.

Maximum adjustment –the maximum correction to be applied to the criteria or the measured level where two or more modifying factors are present. The maximum adjustment is 10 dBA where the noise contains two or more modifying factors (excluding the duration correction).

Table 1.1. Modifying Factor Corrections

Factor	Assessment / measurement	When to apply	Correction¹	Comments
Tonal noise	One-third octave or narrow band analysis	Level of one-third octave band exceeds the level of the adjacent bands on both sides by: -- 5 dB or more if the centre frequency of the band containing the tone is above 400 Hz -- 8 dB or more if the centre frequency of the band containing the tone is 160 to 400 Hz inclusive -- 15 dB or more if the centre frequency of the band containing the tone is below 160 Hz	5 dB ²	Narrow-band frequency analysis may be required to precisely detect occurrence
Low frequency noise	Measurement of C-weighted and A-weighted level	Measure/assess C- and A-weighted levels over same time period. Correction to be applied if the difference between the two levels is 15 dB or more	5 dB ²	C-weighting is designed to be more responsive to low-frequency noise
Impulsive noise	A-weighted fast response and impulse response	If difference in A-weighted maximum noise levels between fast response and impulse response is greater than 2 dB	Apply difference in measured levels as the correction, up to a maximum of 5 dB	Characterised by a short rise time of 35 milliseconds (ms) and decay time of 1.5s
Intermittent noise		Level varies by more than 5 dB	5 dB	Adjustment to be applied for night-time only .
Duration	Single-event noise duration may range from 1.5 min to 2.5 h	One event in any 24-hour period	0 to -20 dBA	The acceptable noise level may be increased by an adjustment depending on duration of noise.(see table 1.2)
Maximum adjustment	Refer to individual modifying factors	Where two or more modifying factors are indicated	Maximum correction of 10 dBA ² (excluding duration correction)	

Notes :

1. Corrections to be added to the measured or predicted levels.
2. Where a source emits tonal and low-frequency noise, only one 5-dB correction should be applied if the tone is in the low-frequency range.

Table 1.2 Adjustments for duration

Duration of noise (one event in any 24 hour period)	Increase in acceptable noise level, dBA	
	Daytime and evening (7 am to 11 pm)	Night-time (11 pm to 7 am)
1.0 to 2.5 hours	2	Nil
15 minutes to 1 hour	5	Nil
6 minutes to 15 minutes	7	2
1.5 minutes to 6 minutes	15	5
Less than 1.5 minutes	20	10